

*SLIII Pendant, Surface and Wall*

WHEN REPLACING PCB ASSEMBLIES, PLEASE WEAR AN ESD WRIST STRAP AND CONNECT IT TO ELECTRICAL GROUND

RISK OF FIRE AND ELECTRICAL SHOCK

Contact, improper installation, or improper servicing MAY RESULT IN DEATH OR SERIOUS INJURY! Fixture must be installed by a qualified electrician only. Fixture is intended for installation in accordance with the National Electrical Code, local and federal code specifications. Disconnect power at electrical panel before servicing. Retain these instructions for maintenance reference.

ADVERTENCIA: RIESGO DE INCENDIO O IMPACTO ELÉCTRICO

Conexión, instalación inapropiada o servicio incorrecto PUEDE CAUSAR MUERTE O HERIDAS GRAVES. La luminaria debe ser instalada únicamente por un eléctrico calificado. La luminaria debe instalarse de acuerdo al Norma eléctrica nacional, al igual que especificaciones locales y normas federales. Se debe desconectar la corriente eléctrica antes de realizar la mantención. Conservar estas instrucciones como referencia para futuras mantenciones.

ATTENTION: RISQUE D'INCENDIE ET D'ELECTROCUTION

Une installation, un entretien ou un contact physique non conforme pourraient mener à un DANGER DE MORT OU DE BLESSURE GRAVE! L'appareil doit être installé uniquement par un électricien professionnel qualifié. L'installation doit respecter le code électrique national de même que les lois locales et fédérales en vigueur. Veuillez fermer l'alimentation électrique au panneau principal avant tout entretien. Conserver ces instructions pour référence et tout entretien futur.

NOTE

National or municipal codes must be followed regarding fixture installation and set back of thermal insulating material from luminaire. As a guideline, any insulation material must be held away from the luminaire by minimum of 3". Fixtures are not designed for direct contact with thermal insulation.

Maintenance - Turn off power first!

To replace LED Boards:

- 1) Do not remove geartrays, Zumtobel offers kits to replace the LED Boards
- 2) Be sure to wear ESD protection!

To replace Driver:


- 1) Contact Zumtobel for authorization
- 2) Be sure to wear ESD protection!

When replacing PCB Assemblies, please wear an ESD wrist strap and connect it to the metal enclosure.




i Overview


Individual Bodies

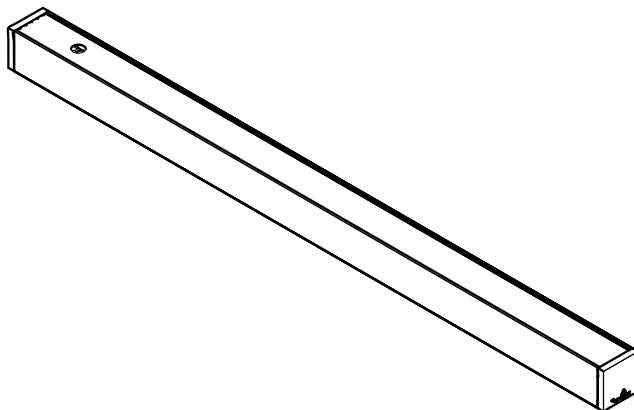

Start/End Pendant Bodies



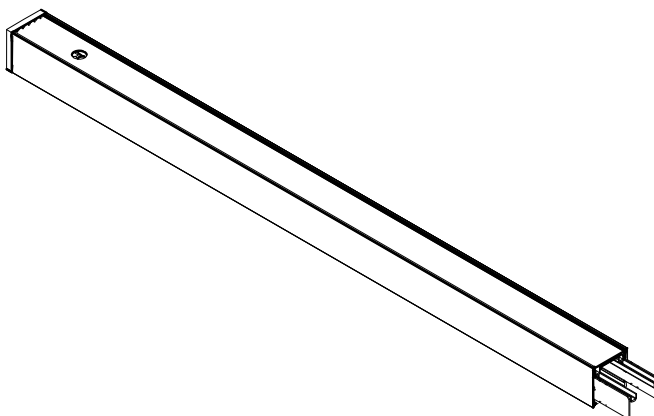


Mid Pendant Bodies

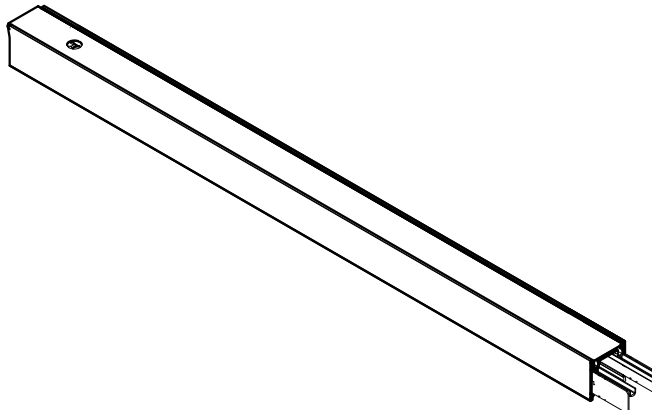


Width	Weight LB/FT
1.5"	4
2.5"	4
4"	5

i Lens Removal

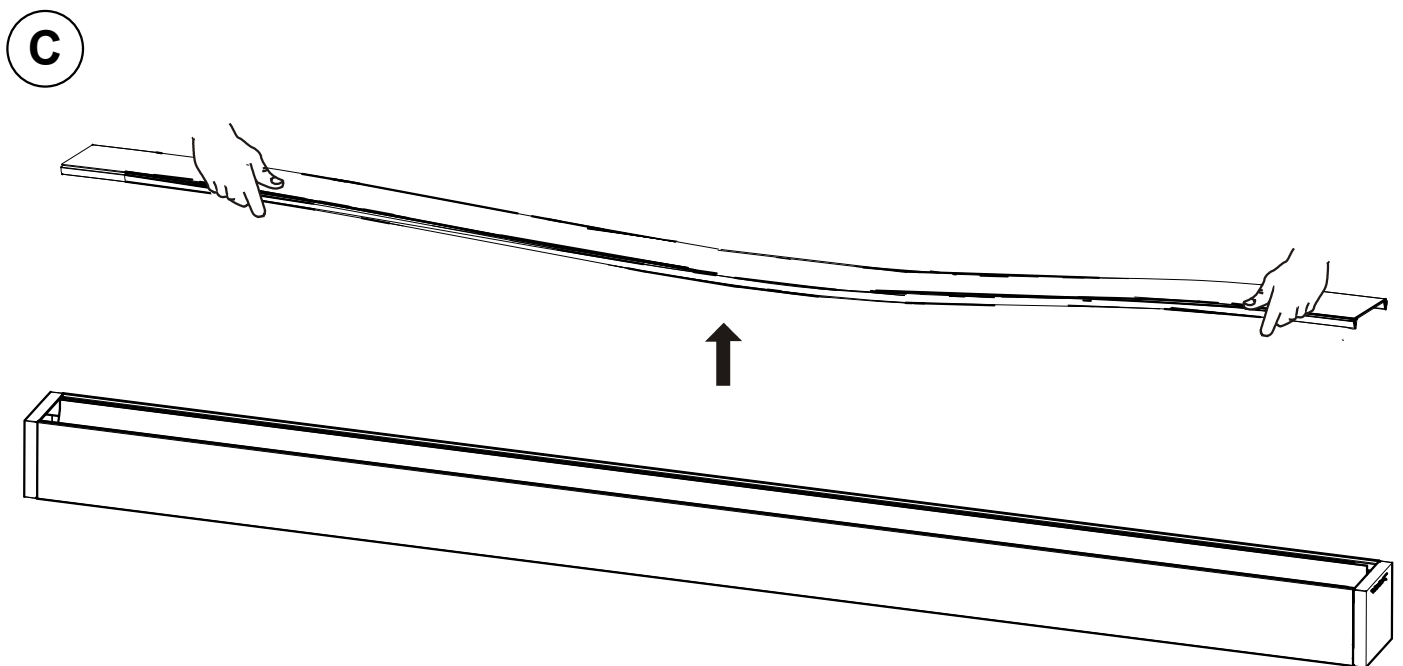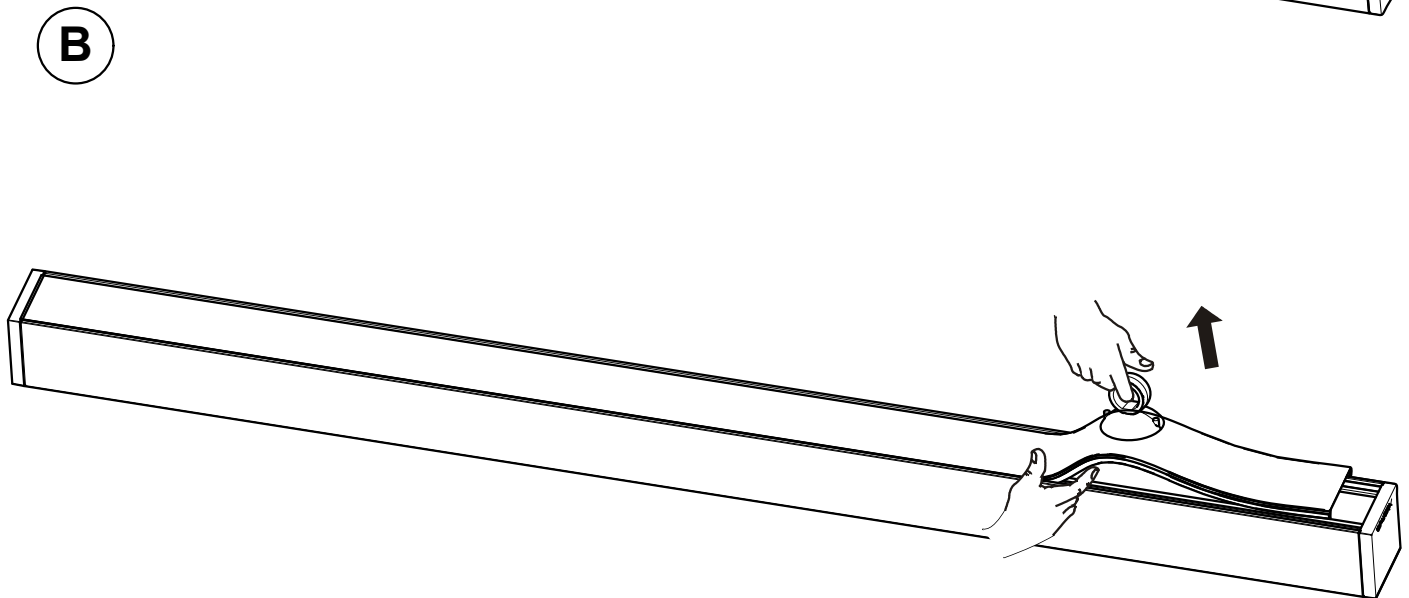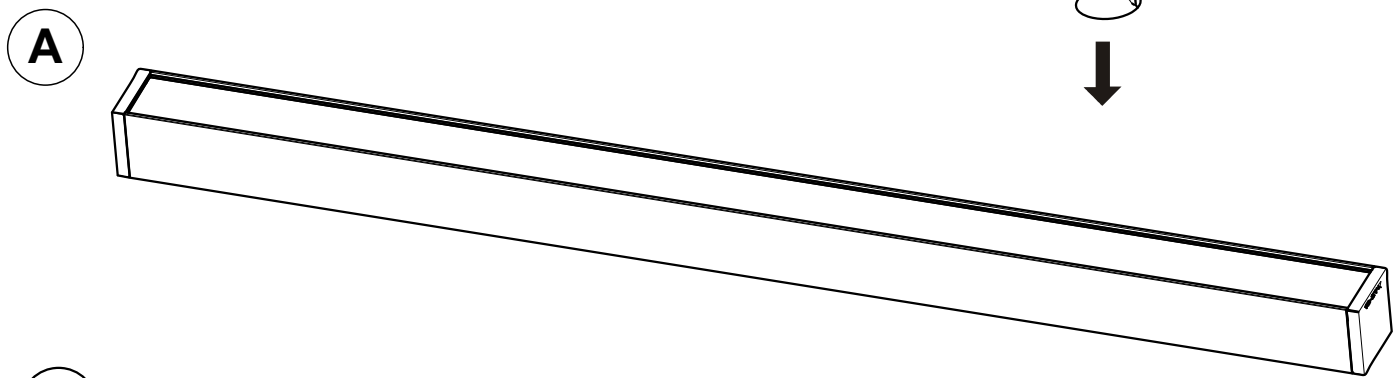


i Gear Tray Removal

A

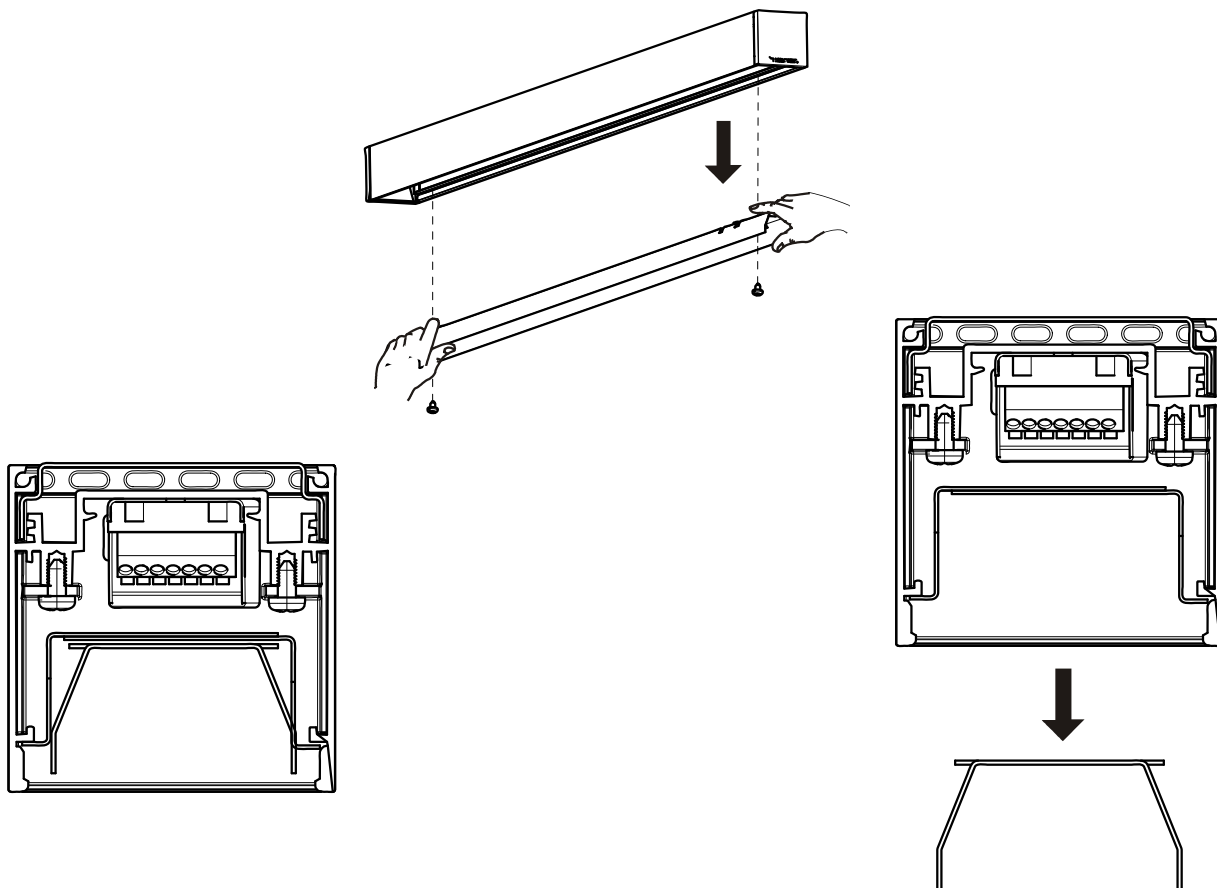


B

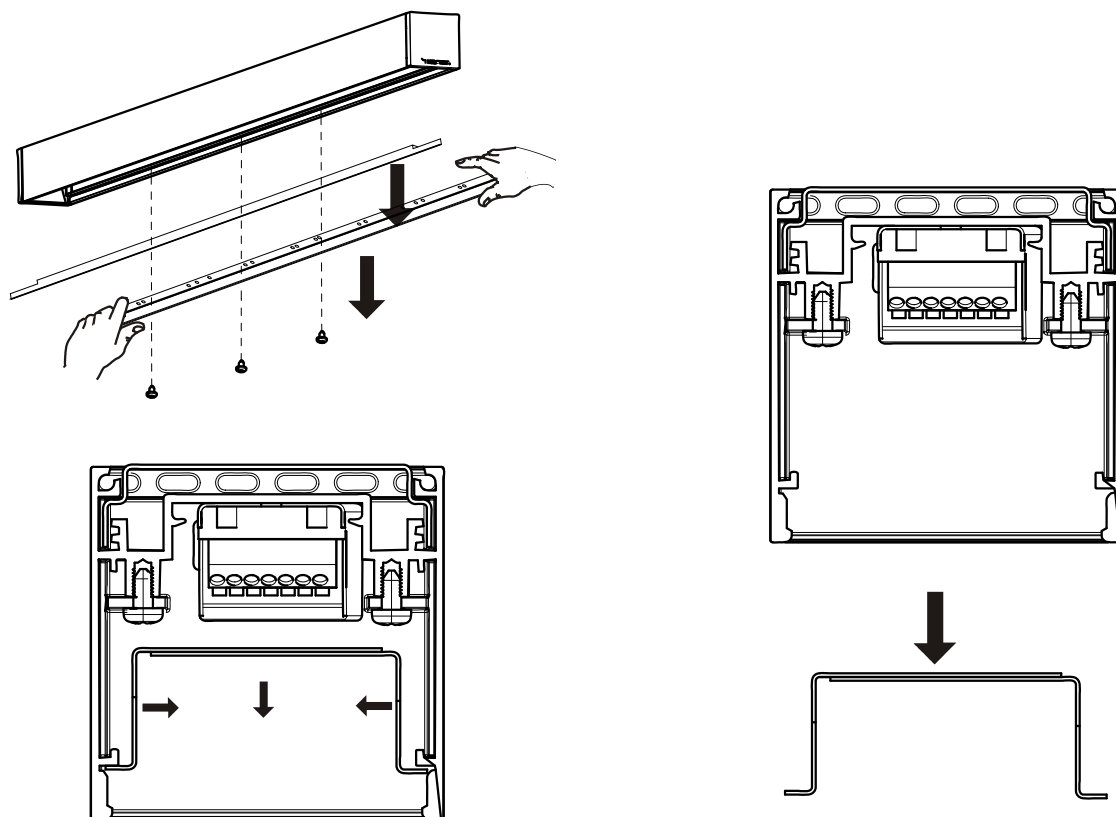


i Pendant Mounting

Unpack fixture. Fixture is shipped pre-assembled with power cord attached. Suspension hardware packaged separately from fixture.




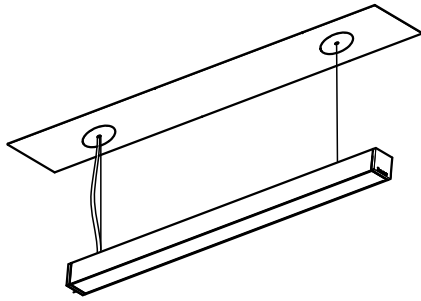


IMPORTANT:

1. When moving suspension cables along fixture, support fixture from underside so suspension moves freely in housing channel
2. Suspension Bracket should not be under load while sliding in channel.
3. Suspension cables should be perpendicular to the Housing
4. This installation requires proper support as each luminaire is being installed. DO NOT attempt to join luminaires together on the floor. Damage may result when lifted. Installation and joining of run must be done while suspended.
5. Suspension cable and sling MUST be perpendicular to fixture and ceiling.

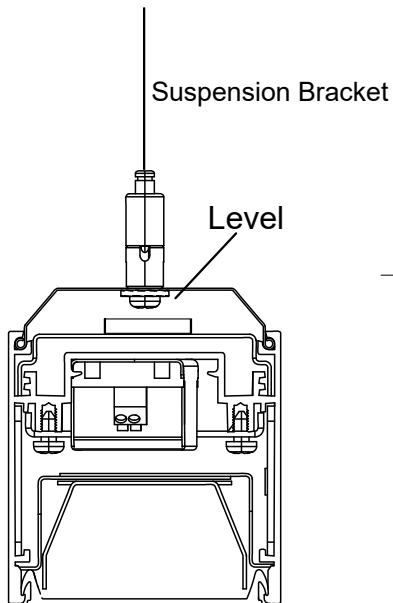

A=2" ~8"

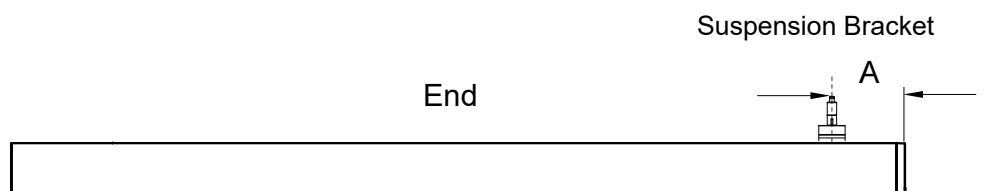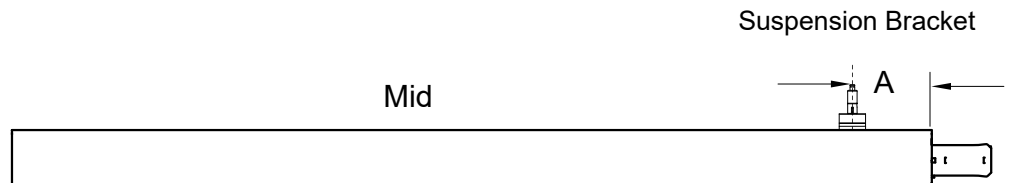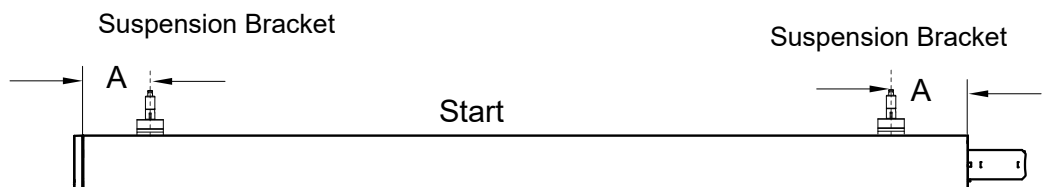
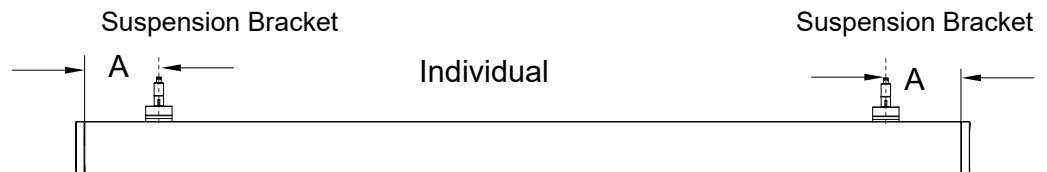


i Pendant Wiring



Junction Box supplied by others



A

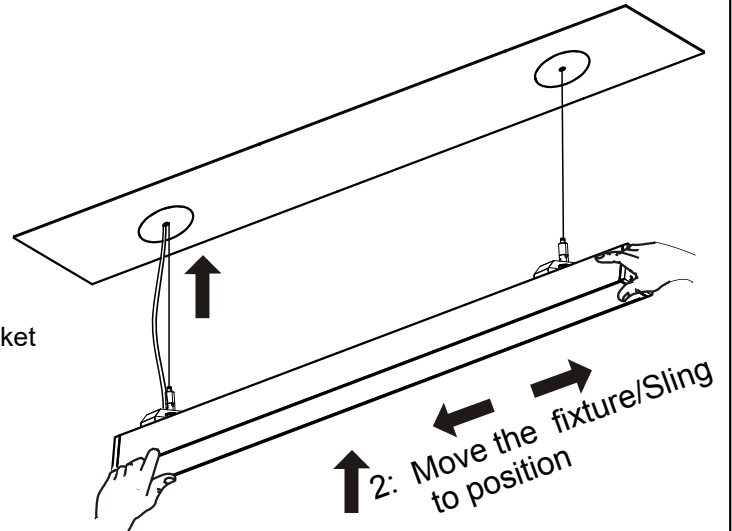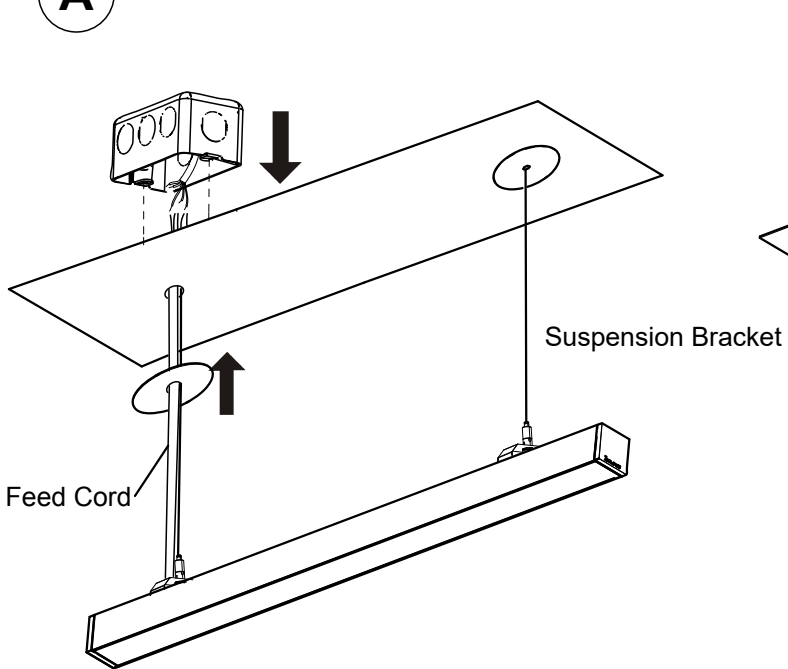




1: Lift the fixture slightly

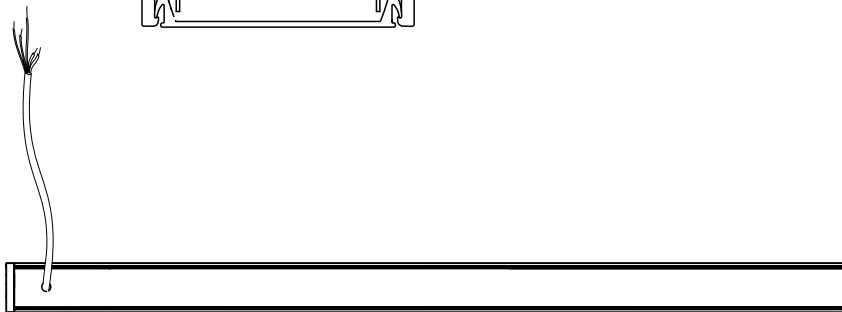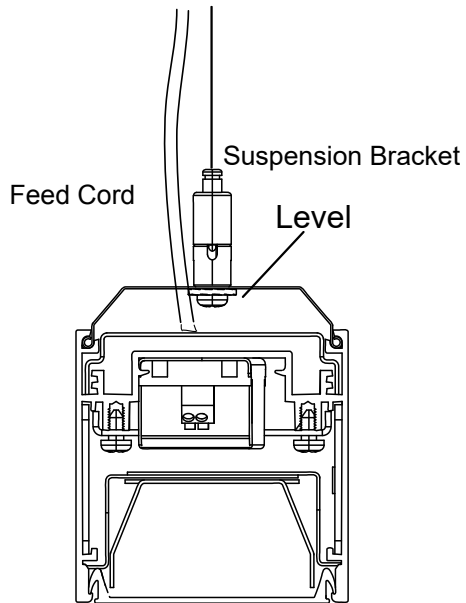




Color Codes	
Black	Load
White	Neutral
Green	Ground
Red	Unswitched Hot
Violet	Control +
Gray	Control -

i For continuous run



Joiner

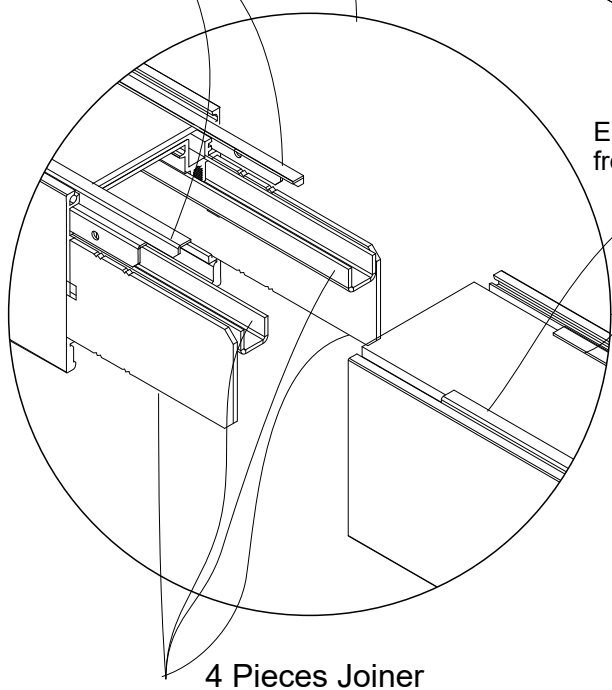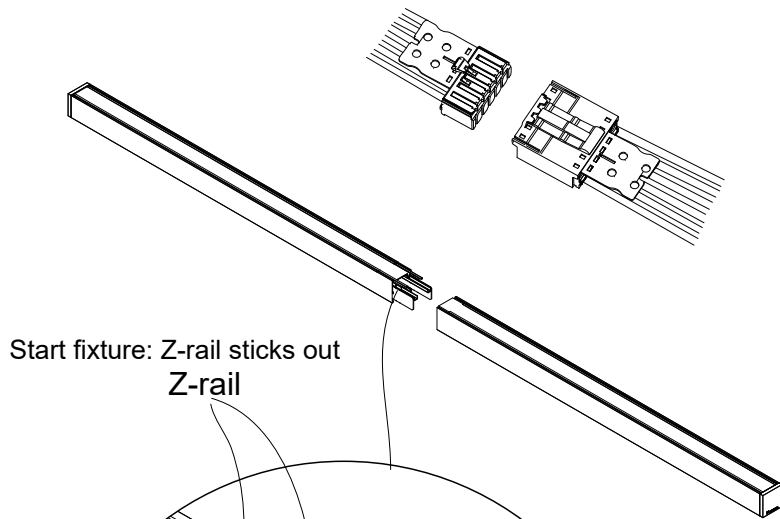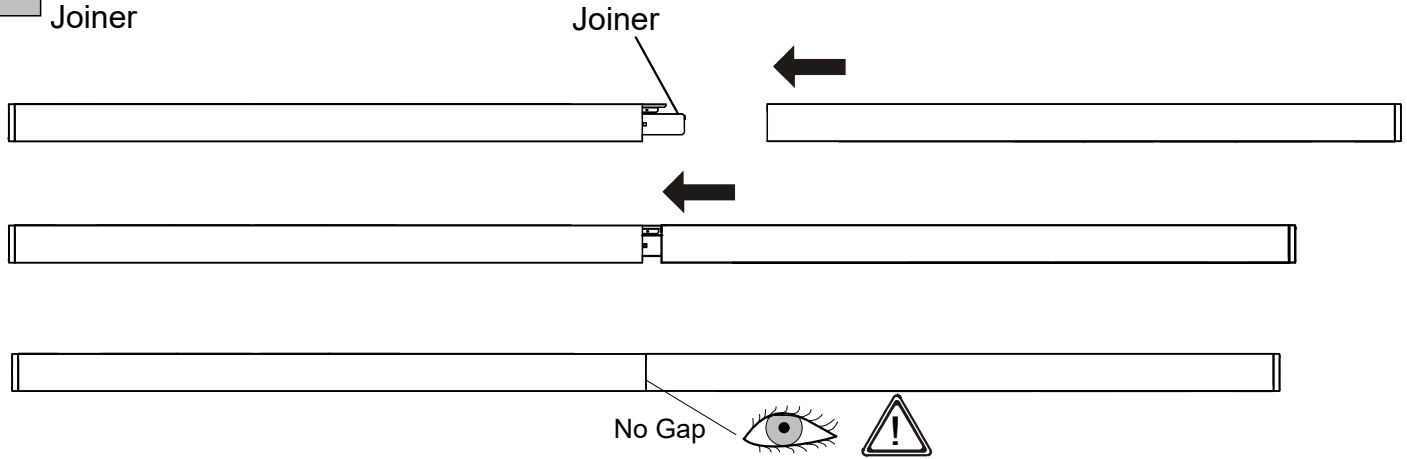

4 screws for two brackets

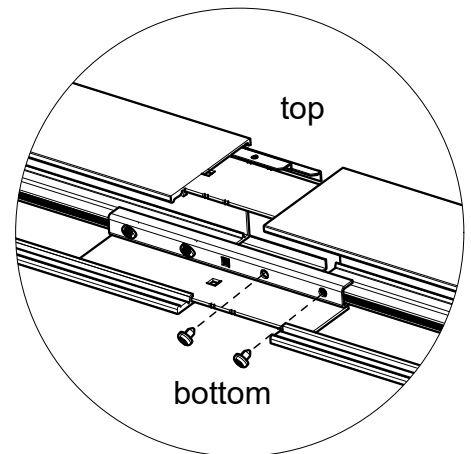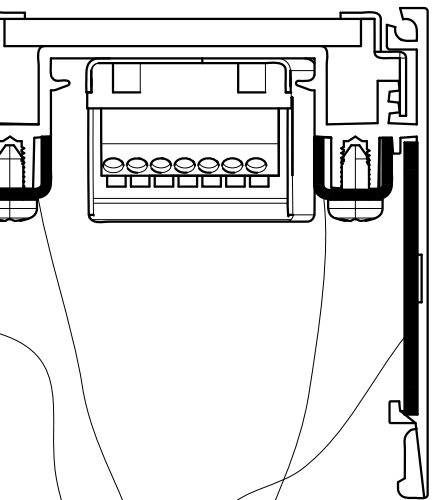



i Gear Tray Installation

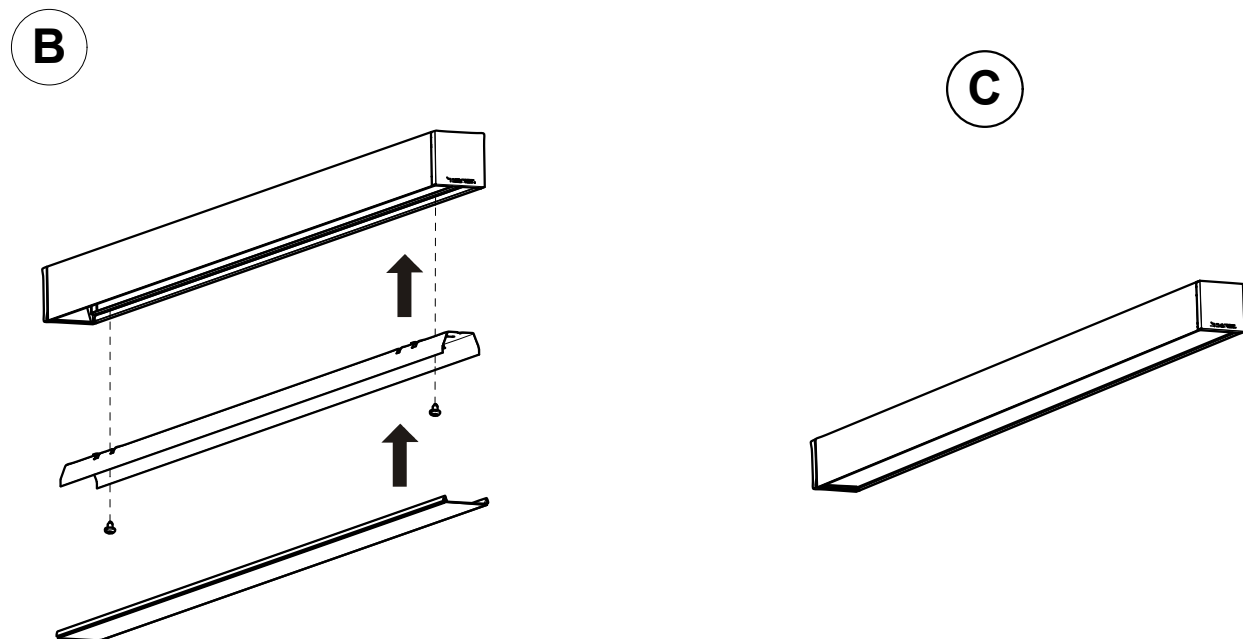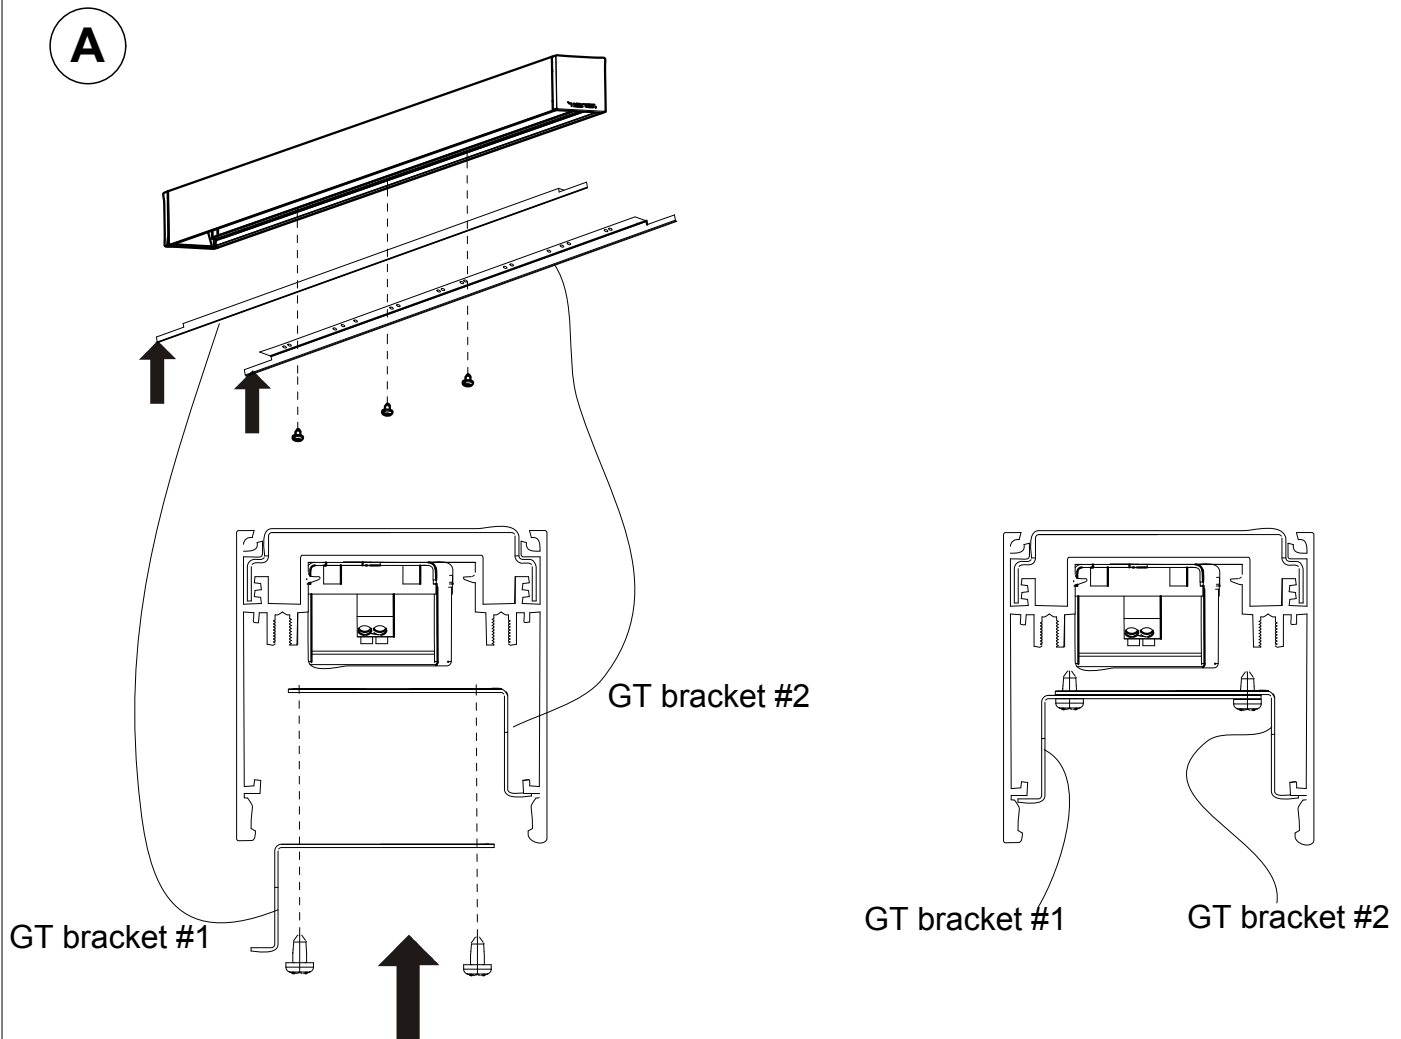

i For continuous run

Rollable Lens Installation


Measure fixture from end cap to end cap, cut roll 1/2 inch longer than opening length

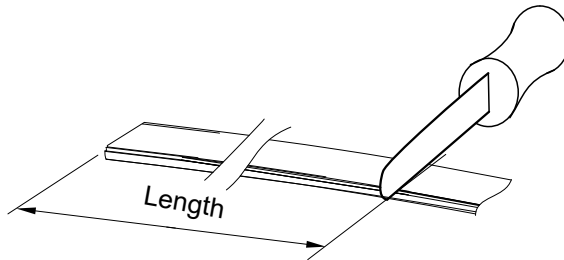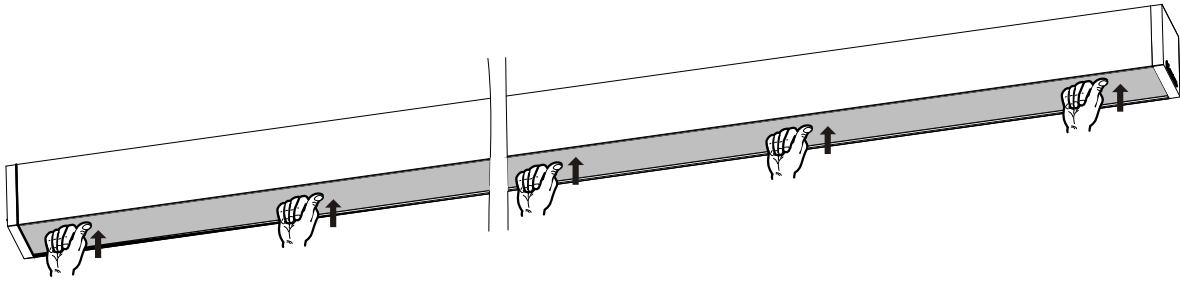


DO NOT REMOVE FILM FROM LENS PRIOR TO INSTALL

LENS MUST REMAIN BAGGED UNTIL LENS INSTALLATION



For over 150 FT long fixtures, the lens joiner will be needed for Lens connection

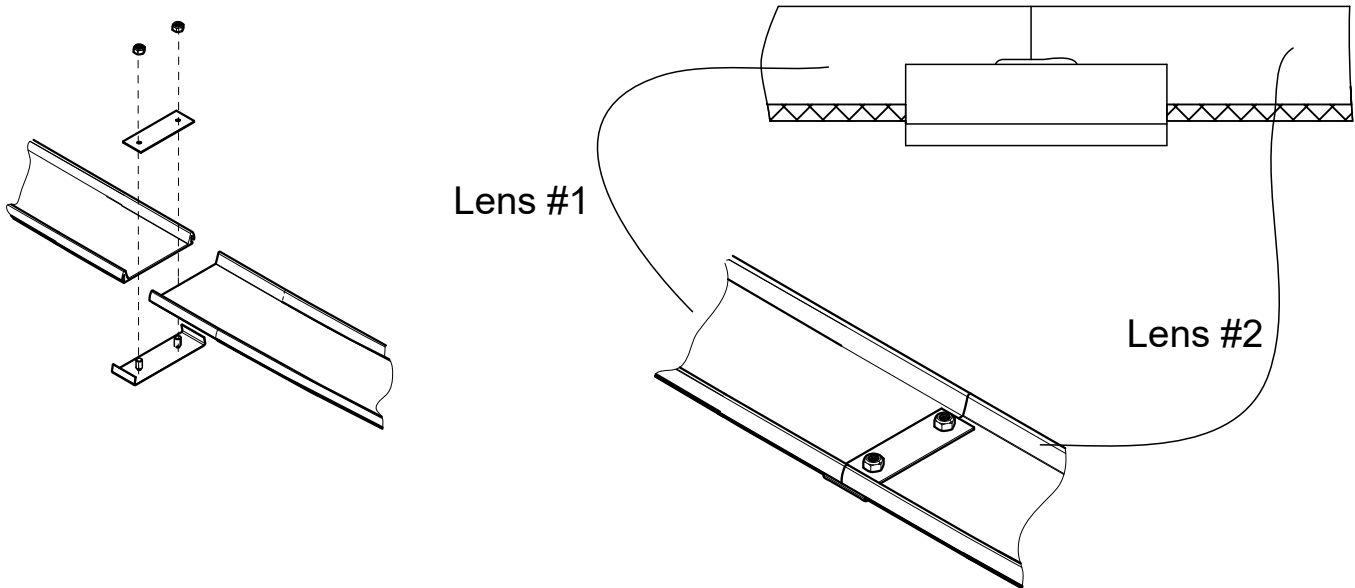

i Rollable Lens Installation

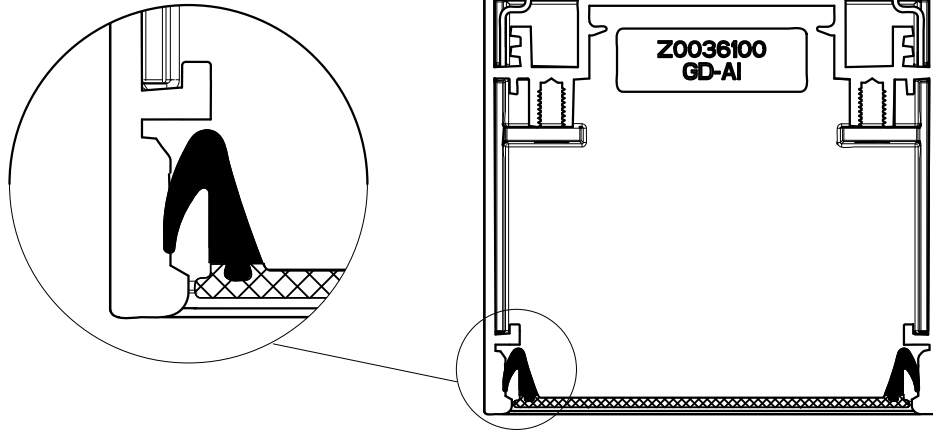


A

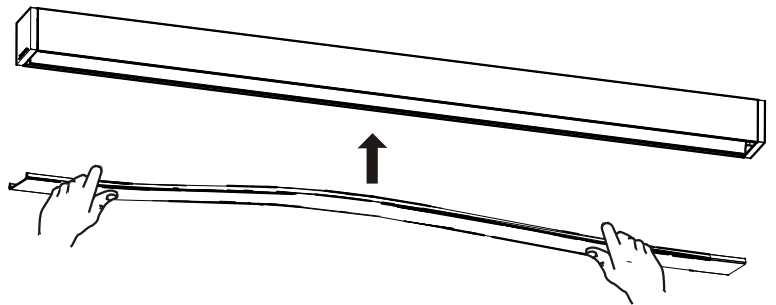


INSERT LENS BEHIND
LENS EXPANSION
SHELF

B

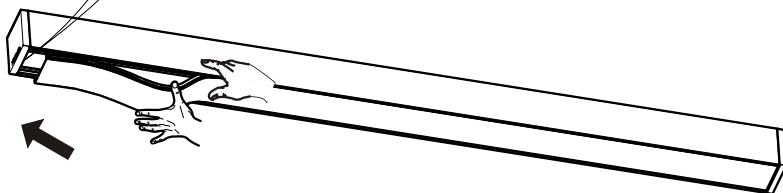

C

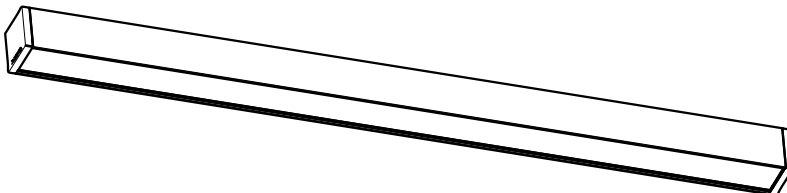

D

Once installed remove protective film

